



*Kingfisher Company, inc.*

## Analog Single Loop Module KFALC-198S



*KF-ALC-198S*

### **Features:**

- Provides an additional analog loop to the FX2003 addressable panel
- Loop consists of 99 analog sensors and 99 addressable modules
- Equipped with programmable alarm verification to provide greater immunity to false alarms
- Easy to install/remove for service

### **Description:**

The KFALC-198S Single Analog Loop Controller Module provides an additional analog loop to the FX-2003 consisting of 99 Analog Sensors and 99 Addressable Modules. The KFALC-198S occupies one module slot in the FX-2003 main or expander chassis.

## Specifications:

<b>Normal Operating Voltage:</b>	Standby: .035A Alarm: .05A
<b>Power Limited:</b>	22 VDC, 400 mA max,
<b>Maximum loop resistance:</b>	40 ohms
<b>Temperature Range:</b>	0°C to 49°C (32°F to 120°F)
<b>Humidity:</b>	10% to 93% Noncondensing
<b>Weight:</b>	0.85 lbs 0.39 kg

## ORDERING INFORMATION

KCi #	Model #	Description
52101	KFALC-198S	Analog Single Loop Module
52101-DTS		Data Specification Sheet


Kingfisher Company, inc., products must be used within their published specifications and must be PROPERLY specified, applied, installed, operated, maintained and operationally tested in accordance with their installation instructions at the time of installation and at least twice a year or more often and in accordance with local, state and federal codes, regulations and laws. Specification, application, installation, operation, maintenance and testing must be performed by qualified personnel for proper operation in accordance with all of the latest National Fire Protection Association (NFPA), Underwriters' Laboratories (UL), National Electrical Code (NEC), Occupational Safety and Health Administration (OSHA), local, state, county, province, district, federal and other applicable building and fire standards, guidelines, regulations, laws and codes including, but not limited to, all appendices and amendments and the requirements of the local authority having jurisdiction (AHJ).

NOTE: Due to continuous development of our products, specifications and offerings are subject to change without notice in accordance with Kingfisher Company, inc., standard terms and conditions

**Kingfisher Company, inc.** 81 Old Ferry Road - Lowell, MA 01854  
Phone: 978-596-0214 Fax: 978-596-0217 [www.kfci.com](http://www.kfci.com)

## DRAWINGS OR DIAGRAMS

### Wiring Diagram:

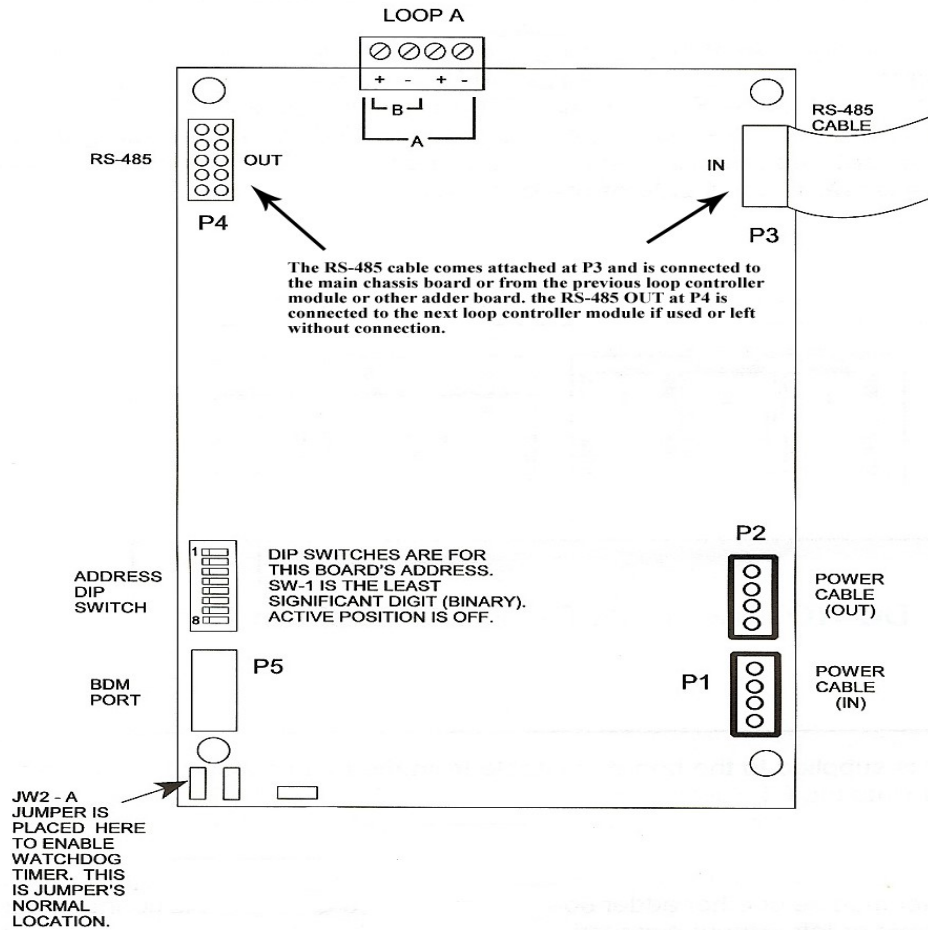

ALC-198S SINGLE INTELLIGENT ANALOG LOOP CONTROLLER MODULE

**Kingfisher Company, inc.** 81 Old Ferry Road - Lowell, MA 01854  
 Phone: 978-596-0214 Fax: 978-596-0217 [www.kfci.com](http://www.kfci.com)

BLANK PAGE LEFT  
INTENTIONALLY

**Kingfisher Company, inc.** 81 Old Ferry Road - Lowell, MA 01854  
Phone: 978-596-0214 Fax: 978-596-0217 [www.kfci.com](http://www.kfci.com)