



Kingfisher Company, inc.

99332 IOT-08-DC IP ALARM TRANSMITTER With DIALER CAPTURE

Features:

- **IOT-08-DC** can be connected to standard fire panels with dry contact outputs, Contact-ID compatible DACT, or serial interface
- System parameters can be easily programmed by an Android, iOS, or Windows mobile device or laptop
- 8 Input Zones that can transmit Emergency Response signals such as Fire, Medical, Supervisory, Police, etc.
- Built-in point reporting via Ademco Contact-ID compatible dialer capture module
- Point reporting with user labels via on board intelligent serial data interface
- Meets and exceeds NFPA 72 and 1221 standards
- Integral AC line power with backup battery management or +24VDC power from FACP
- Two on-board relays for control functions with support for up to 64 additional relays that can be individually controlled
- Cellular, WiFi, Ethernet communication paths supported with automatic on-the-fly selection of multiple cellular carriers
- Robust cybersecurity supports 4 rotations of 2K-bit Advanced Encryption Standard hardware / software encryption with TLS security



IOT-08-DC
IP Emergency Event Transmitter

Description:

The **IOT-08-DC** IP Alarm Transmitter with Dialer Capture is a self-contained Auxiliary Signaling Device that captures point specific event data from Ademco Contact-ID compatible DACT devices, serial ports, and dry contacts and transmits encoded emergency event messages to a compatible Kingfisher receivers using IoT technology. The IOT transmitter communicates automatically over Ethernet, Wifi, and cellular with automatic media path and carrier selection. The IOT-08-DC also supports an intelligent serial interface that will transmit FACP printer data including custom user labels. The **IOT-08-DC** is contained in a NEMA-1 cabinet and derives power from a 120VAC branch circuit and maintains a 12V backup battery for secondary power, or can be powered from the +24VDC output of any FM or UL listed FACP. Programming is easily accomplished in the field using a standard Android or iOS mobile device.

Operation:

The IOT-08-DC transmitter is a microprocessor-based device that utilizes state of the art Internet of Things (IoT) technology to generate an alarm message based on input conditions and transmit the message on a secure channel to the KCi secure cloud using wired Ethernet, WiFi, or hardened cellular communications paths. Event data can be point specific using the Ademco Contact-ID dialer capture or intelligent serial interface, or conventional using 8 on-board dry contact input zones.

The IOT-08-DC transmitter simultaneously monitors eight Class B input zones, a dual line dialer capture interface, and an intelligent serial interface. Point specific information is captured in Ademco Contact-ID format using the dialer capture interface, and point specific printer data including custom user programmed point labels from a compatible FACP can be captured via the intelligent serial port. When an alarm condition is validated the IOT-08-DC transmitter builds a secure encrypted alarm message based on the specific input activation which is then transmitted on wired Ethernet, WiFi, and hardened cellular communication channels with automatic carrier and media selection. The IOT-08-DC continuously scans for and will automatically select the cellular carrier with the strongest signal, and supports ATT, T-Mobile, Verizon, US Cellular, and most second tier carriers. Four rotations of 2Kbit hardware encryption is used for enhanced communication security.

Specifications:

Alarm Interface	
Monitored Dry Contact Inputs	8 (each input monitors ONE dry contact)
Ground Fault Detection Resistance	< 100 Ω
Input Termination Resistance	10 k Ω
Dialer Capture Interface	Ademco Contact-ID Compatible
Ring Voltage	48VDC
Intelligent Data Port	RS-232
AC Power Input (Input)	
AC VoltageRange	120 / 240 VAC Nominal, Single Phase
AC Frequency	50-60 Hz
AC CurrentDraw	< 0.5 A
AC Fuse	2A Glass 5mm x 20mm
Backup Battery Type	Sealed Lead Acid, Pure Lead Acid, Lithium
Backup Battery Voltage	12.0 V nominal
Backup Battery StandbyDuration	> 96 Hr (7.0 AH or 5.0 AH, using KCi PN 17014)
Backup Battery Recharge Time	< 24 Hr
Battery Fuse	2ASB
Current Draw	
Standby Current Draw	0.167A
Alarm Current Draw	0.170A
Communication	
Media	Cellular 5G/LTE/4G/3G/2G, Ethernet, WiFi 2.4/5Ghz
Carriers	ATT/FirstNet, T-Mobile, Verizon, US Cellular auto-selection
Environmental	
Temperature Range – Operational	0°C through 50°C (32°F - 120°F)
Temperature Range – Storage	-20°C through 70°C (-4°F - 158°F)
Humidity	< 95% non-condensing

Kingfisher Company, inc. 81 Old Ferry Road - Lowell, MA 01854
 Phone: 978-596-0214 Fax: 978-596-0217 www.kfci.com

ORDERING INFORMATION

KCi #	Model #	Description
99332	IOT-08-DC	IOT (IP) Transmitter with Dialer Capture and 8 Zones, 120VAC
Options		
66330	IOT-08-RM	8-Zone Relay Expander Module
17200	PS1270	Battery, 7AH, 12V, Standard Lead Acid Gel
91421-IOT-25	IOT-ANT-25	IOT External antenna Kit, 25Ft. Coaxial Cable
91421-IOT-50	IOT-ANT-50	IOT External antenna Kit, 50Ft. Coaxial Cable
91421-IOT-75	IOT-ANT-75	IOT External antenna Kit, 75Ft. Coaxial Cable
91421-IOT-100	IOT-ANT-100	IOT External antenna Kit, 100Ft. Coaxial Cable

Installations:

- All installations shall comply with NFPA-72 and NEC-760 requirements and best practices


Kingfisher Company, inc., products must be used within their published specifications and must be PROPERLY specified, applied, installed, operated, maintained and operationally tested in accordance with their installation instructions at the time of installation and at least twice a year or more often and in accordance with local, state and federal codes, regulations and laws. Specification, application, installation, operation, maintenance and testing must be performed by qualified personnel for proper operation in accordance with all of the latest National Fire Protection Association (NFPA), Underwriters' Laboratories (UL), National Electrical Code (NEC), Occupational Safety and Health Administration (OSHA), local, state, county, province, district, federal and other applicable building and fire standards, guidelines, regulations, laws and codes including, but not limited to, all appendices and amendments and the requirements of the local authority having jurisdiction (AHJ).

NOTE: Due to continuous development of our products, specifications and offerings are subject to change without notice in accordance with Kingfisher Company, inc., standard terms and conditions

Kingfisher Company, inc. 81 Old Ferry Road - Lowell, MA 01854
Phone: 978-596-0214 Fax: 978-596-0217 www.kfci.com

DRAWINGS AND DIAGRAMS

Dimensions:

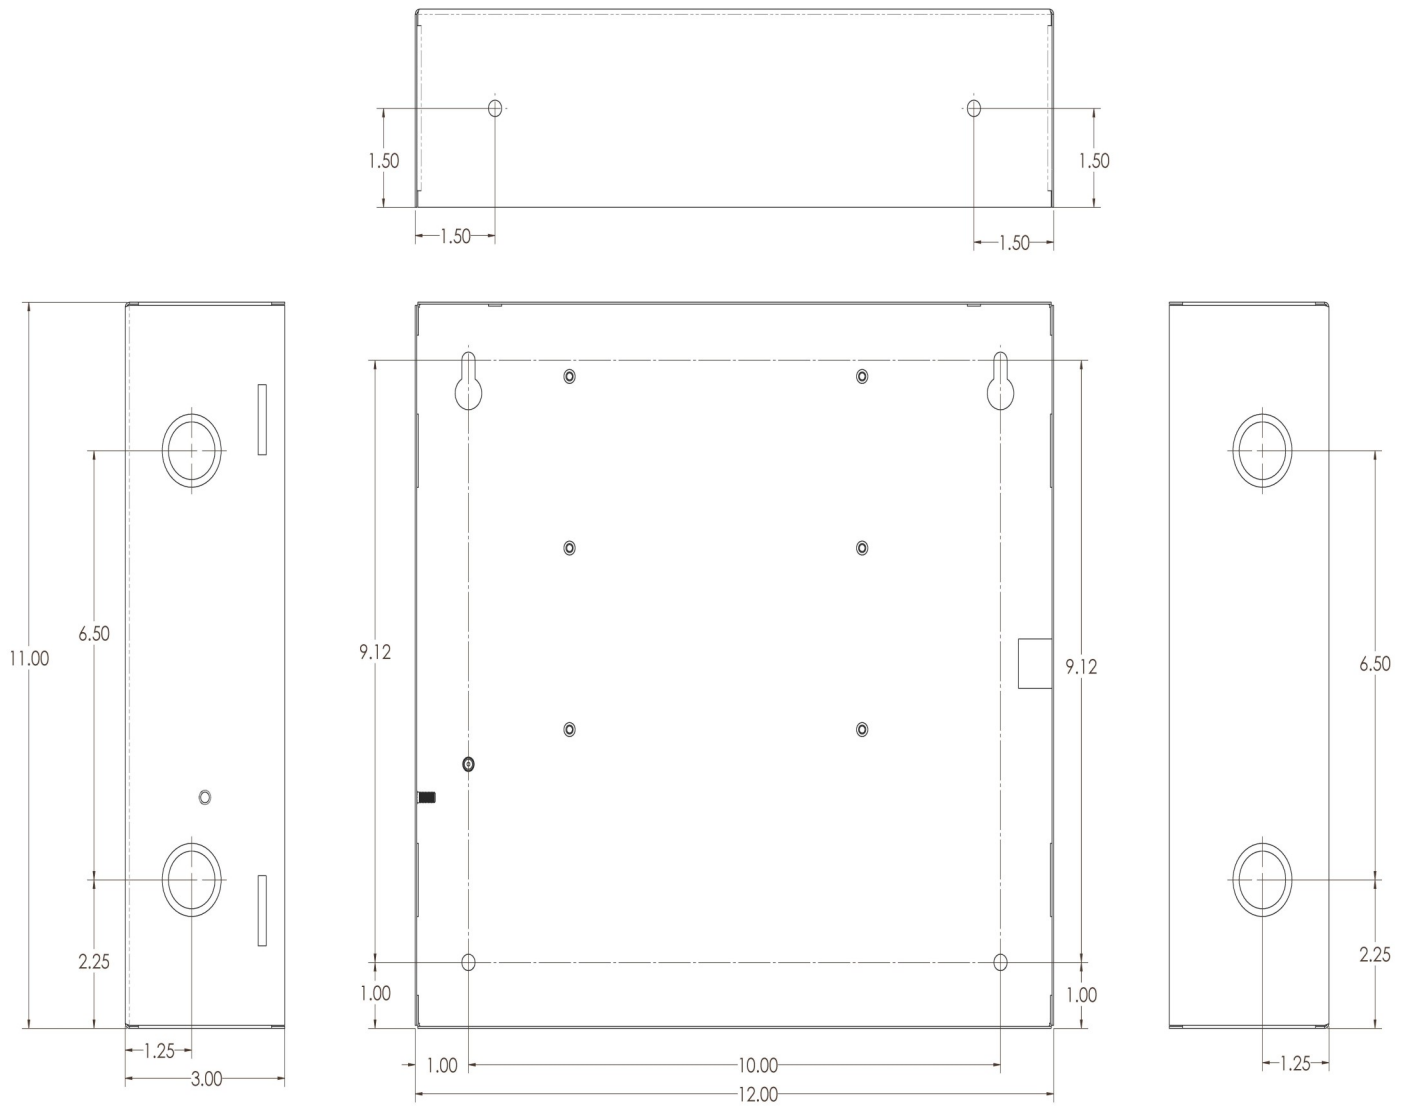

Kingfisher Company, inc. 81 Old Ferry Road - Lowell, MA 01854
Phone: 978-596-0214 Fax: 978-596-0217 www.kfci.com